



((



Size: DN 15 to DN 200 Ends: Flanges R.F. PN40

Min Temperature : - 20°C Max Temperature : + 400°C Max Pressure : 40 Bars

Specifications: Non rising stem

Bolted bonnet and gland pack

Stainless steel bellow

Materials: Carbon steel

SPECIFICATIONS:

- · Respect the flow direction indicated by the arrow
- Non rising stem
- · Bolted bonnet and gland pack
- · Stainless steel bellow
- · Pressed seat in the body
- · Anti-turn device to avoid the risk of torsion of bellows
- Flanges R.F. PN40
- RAL 5002 blue painting, 15µ thickness

USE:

- · Common fluids of 2nd group , steam , thermic fluid
- Min and max Temperature Ts: 20°C to + 400°C
- Max Pressure Ps: 40 bars (see graph under)
- · Keep greased the stem


FLOW COEFFICIENT Kvs (M3/h):

DN	15	20	25	32	40	50	65	80	100	125	150	200
Kvs (m3/h)	3.8	7	10	19	35	43	60	110	146	210	300	670

PRESSURE / TEMPERATURE GRAPH:

Pressure (Bar)




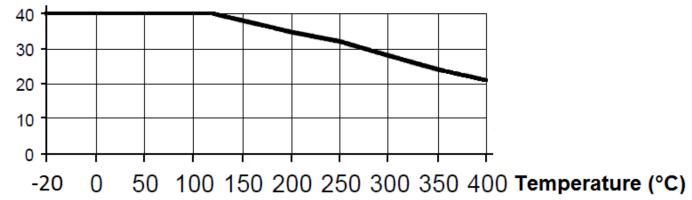

RANGE :


Carbon steel globe valve with stainless steel bellow flanged R.F. PN40 from DN 15 to DN 200 Ref. 475

MATERIALS:

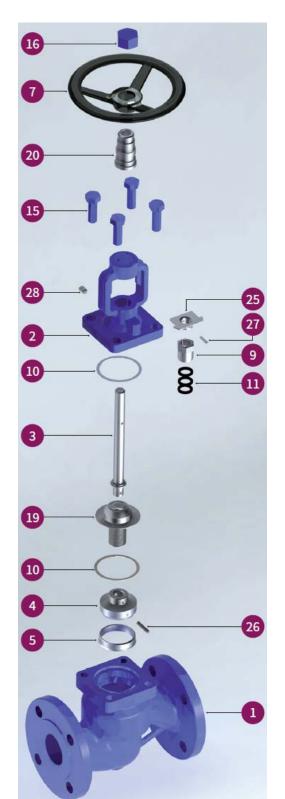


Item	Designation	Materials						
1	Body	ASTM A216 WCB						
2	Bonnet	ASTM A216 WCB						
3	Stem	SS 303 (1.4305)						
4	Disc	SS 420 (1.4021)						
5	Seat	X 22 CrNi 17 (1.4059)						
7	Handwheel	Ductile iron EN GJS-400						
9	Gland	EN 10087						
10	Gasket	Graphite						
11	Packing	Graphite						
15	Screw	8.8						
16	Handwheel nut	EN 10087						
19	Bellow	SS 316 Ti (1.4571)						
20	Threaded bushing	EN 10087						
25	Anti turn device	EN 10025						
26	Pin	SS 304						
27	Pin	SS 304						
28	Lubricator	-						

SIZE (in mm):

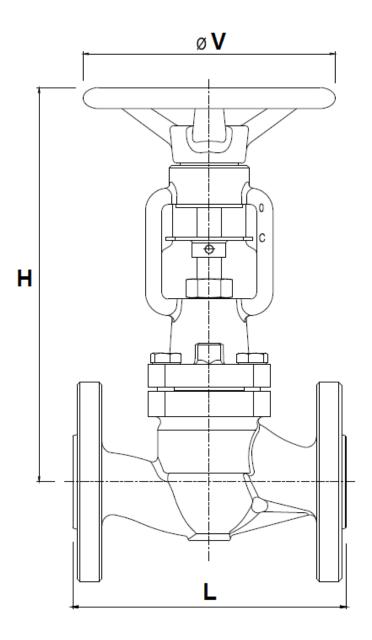

Ref.	DN	15	20	25	32	40	50	65	80	100	125	150	200
475	L	130	150	160	180	200	230	290	310	350	400	480	600
	Н	190	195	220	219	254	265	328	341	376	488	531	663
	øν	140	140	140	140	180	180	200	200	250	330	330	400
	Weight (Kg)	3.7	4.8	6.8	7.8	13	15.5	23	28	43	68	100	202

FLANGES SIZE (in mm):

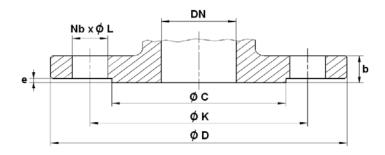

DN	15	20	25	32	40	50	65	80	100	125	150	200
øс	45	58	68	78	88	102	122	138	162	188	218	285
Ø D	95	105	115	140	150	165	185	200	235	270	300	375
øк	65	75	85	100	110	125	145	160	190	220	250	320
Nb x Ø L	4 x 14	4 x 14	4 x 14	4 x 18	4 x 18	4 x 18	8 x 18	8 x 18	8 x 22	8 x 26	8 x 26	12 x 30
b	16	18	18	18	18	20	22	24	24	26	28	34
е	2	2	2	2	3	3	3	3	3	3	3	3

STANDARDS:

- Fabrication according to ISO 9001 :2008
- Designing according to DIN 3840
- Marking according to EN 19
- DIRECTIVE 97/23/CE : CE N° 0035 Risk Category III module H
- Pressure Tests according to EN 12266-1, range A
- Length according to EN 558 series 1 (DIN 3202 F1)
- Flanges R.F. according to EN 1092-1 PN40
- Approval certificate Russian Federation GOST-R

ADVICE: Our opinion and our advice are not guaranteed and SFERACO shall not be liable for the consequences of damages. The customer must check the right choice of the products with the real service conditions.

INSTALLATION INSTRUCTIONS

GENERAL GUIDELINES:

- Ensure that the valves to be used are appropriate for the conditions of the installation (type of fluid, pressure and temperature).
- Be sure to have enough valves to be able to isolate the sections of piping as well as the appropriate equipment for maintenance and repair.
- Ensure that the valves to be installed are of correct strength to be able to support the capacity of their usage.
- Installation of all circuits should ensure that their function can be automatically tested on a regular basis (at least two times a year).

INSTALLATION INSTRUCTIONS:

- Before installing the valves, clean and remove any objects from the pipes (in particular bits of sealing and metal) which could obstruct and block the valves.
- Ensure that both connecting pipes either side of the valve (upstream and downstream) are aligned (if they're not,the valves may not work correctly).
- Make sure that the two sections of the pipe (upstream and downstream) match, the valve unit will
 not absorb any gaps. Any distortions in the pipes may affect the thightness of the connection, the
 working of the valve and can even cause a rupture. To be sure, place the kit in position to ensure the
 assembling will work.
- If sections of piping do not have their final support in place, they should be temporarily fixed. This is to avoid unnecessary strain on the valve.
- Tighten the bolts in cross.
- It's recommended to operate the valve (open and close) 1 to 2 times per year
- Tighten the gland packing at the first start of the installation (with a moderate torque) so that there's no leakage and the handwheel is easy to operate.
- Do not use tools to operate the handwheel
- Respect the flow direction indicated by the arrow